

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603, Fax: (281) 540-9966
Website: forceengineeringtesting.com

Product Evaluation Report
MID FLORIDA METAL ROOFING SUPPLY, INC.

Minimum 26 Ga. MFMRS PBR Roof Panel over open framing

Florida Product Approval # 23310.1 R2

Florida Building Code 2020
Per Rule 61G20-3
Method: 1 –D

Category: Structural Components
Subcategory: Roof Deck
Compliance Method: 61G20-3.005(1)(d)
NON HVHZ

Product Manufacturer:
Mid Florida Metal Roofing Supply, Inc.
28328 County Road 561
Tavares, Florida 32778

Engineer Evaluator:
Johnathan Green, P.E. #88223
Florida Evaluation ANE ID: 12901


Validator:
Steven Urich, P.E. #57795

Contents:
Evaluation Report Pages 1 – 5



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

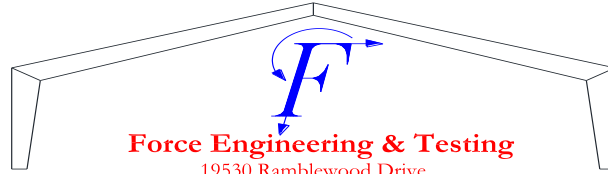

Force Engineering & Testing
 19530 Ramblewood Drive
 Humble, Texas 77338
 Phone: (281) 540-6603, Fax: (281) 540-9966
 Website: forceengineeringtesting.com

- Compliance Statement:** The product as described in this report has demonstrated compliance with the Florida Building Code 2020, Sections 1504.3.2, 1504.7.
- Product Description:** MFMRs PBR Roof Panel, 26 Ga. Steel, 36" Wide, through fastened structural roof panel. Structural Application.
- Panel Material/Standards:** Material: Minimum 26 Ga. Steel, ASTM A792 or ASTM A653 G90 conforming to Florida Building Code 2020 Section 1507.4.3.
 Yield Strength: Min. 80.0 ksi
 Corrosion Resistance: Panel Material shall comply with Florida Building Code 2020, Section 1507.4.3.
- Panel Dimension(s):** Thickness: 0.0185" min.
 Width: 36" maximum coverage
 Rib Height: 1 1/4" major rib at 12" O.C.
- Panel Fastener:** #12-14 x 1-1/4" HWH SD w/ EPDM washing or approved equal.
 1/4-14 x 7/8" HWH SD1 w/ EPDM washer through panel side laps at 20" O.C.
 Corrosion Resistance: Per Florida Building Code 2020, Section 1507.4.4.
- Substrate Description:** Min. 16 Ga. Steel Framing. Framing must be designed in accordance w/ Florida Building Code 2020.

Allowable Design Pressures:

Table "A"

Maximum Design Pressure:	-42.5 psf	+60.0 psf
Fastener Pattern:	12"-12"-12"	12"-12"-12"
Fastener Spacing:	5'-0" O.C.	5'-0" O.C.

*Design Pressure includes a Safety Factor = 2.0



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.



Force Engineering & Testing

19530 Ramblewood Drive

Humble, Texas 77338

Phone: (281) 540-6603, Fax: (281) 540-9966


Website: forceengineeringtesting.com

- Code Compliance:** The product described herein has demonstrated compliance with The Florida Building Code 2020, Section 1504.3.2, 1504.7.
- Evaluation Report Scope:** The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2020, as relates to Rule 61G20-3.
- Performance Standards:** The product described herein has demonstrated compliance with:
- ASTM E 1592-05 (2012) Test method for structural performance of sheet metal roof and siding systems by uniform static air pressure difference.
 - FM 4471-92, Foot Traffic Resistance Test for Roof Panels.
- Reference Data:**
1. ASTM E 1592-01
Force Engineering & Testing, Inc.
Report No. 194-0338T-06A, B
 2. FM 4471-92, Section 5.4 Foot Traffic Resistance Test
Force Engineering & Testing, Inc.
Report No. 194-0134T-11B
 3. Certificate of Independence
By Johnathan Green, P.E. #88223
- Test Standard Equivalency:** The ASTM E 1592-01 test standard is equivalent to the ASTM E 1592-05 (2012) test standard.
- Quality Assurance Entity:** The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

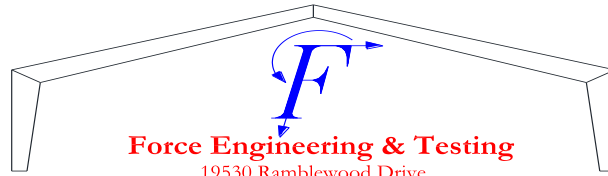

Force Engineering & Testing

19530 Ramblewood Drive

Humble, Texas 77338

Phone: (281) 540-6603, Fax: (281) 540-9966


Website: forceengineeringtesting.com

- Minimum Slope Range:** Minimum Slope shall comply with Florida Building Code 2020, including Section 1507.4.2 and in accordance with Manufacturers recommendations. For slopes less than 3:12, lap sealant must be used in the panel side laps.
- Installation:** Install per manufacturer's recommended details.
- Insulation:** Manufacturer's approved product (Optional)
- Roof Panel Fire Classification:** Fire classification is not part of this acceptance.
- Shear Diaphragm:** Shear diaphragm values are outside the scope of this report.
- Design Procedure:** Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2020 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2020 Chapter 22 for steel, and Chapter 16 for structural loading.



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

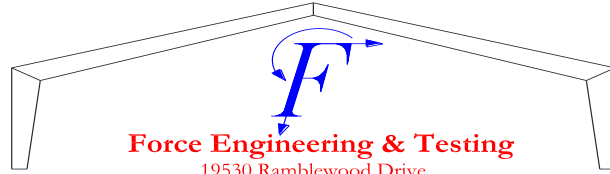

Force Engineering & Testing


19530 Ramblewood Drive

Humble, Texas 77338


Phone: (281) 540-6603, Fax: (281) 540-9966

Website: forceengineeringtesting.com

PANEL INTERIOR FASTENER PATTERN

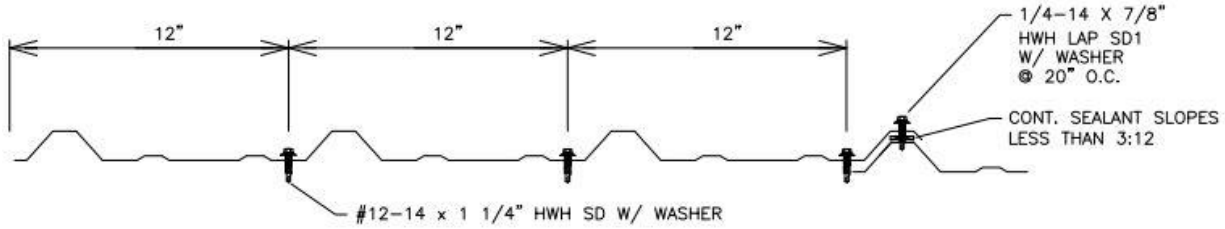

PANEL END AND PANEL END LAPS FASTENER PATTERN

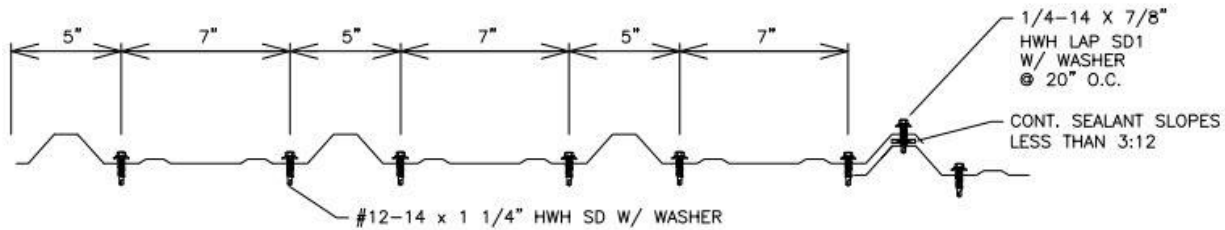

JUN 06 2022

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.